



Technical Specifications CHL 375 GCE


Nominal Input (net)	kW	73
Nominal Input (gross)	kW	81.1
Gas Flow Rate (natural gas)	m ³ /hr	7.7
Nominal Output	kW	66.4
EFFICIENCY DATA-Part L2		
Seasonal Efficiency (Part L2 Gross CV)	%	81
Maintenance Consumption value	MJ/M	808.7
Maintenance Consumption value	kWh/24 Hr	7.5
EFFICIENCY DATA-ErP and Energy Label		
Ecodesign Energy Label rating		B
Water Heater efficiency	%	66
GENERAL DATA		
NOx emission @0% O ₂	mg/kWh	35
Recovery Rate @ 44°C	l/hr	1299
Recovery Rate @ 50°C	l/hr	1143
Recovery Rate @ 56°C	l/hr	1020
Dimension A standard unit (A)	mm	1995
Dimension A with alternative draft diverter type 1 (A)	mm	1880
Dimension A with alternative draft diverter type 2 (A)	mm	2000
Dimensions (diameter)	mm	705
Dimensions (depth)	mm	960
Hot Outlet Connection (Inches)	BSP	R 1½
Cold Feed Connection (Inches)	BSP	R 1½
Gas Connection (Inches)	BSP	Rp ¾
Flue Connection G standard unit	mm	180
Flue Connection G with alternative draft diverter type 1	mm	180
Flue Connection G with alternative draft diverter type 2	mm	180
Storage Capacity	litres	351
Weight (empty)	kg	272
Weight (full)	kg	616
Insulation Thickness	mm	30
Insulation Material		Polyurethane
Electrical Requirements		230V /1Ph/ 50hz
Power Consumption (Peak)	w	120
Sound Power Level	LWA(db)	68
Maximum Flue Gas Temperature	°C	172
Max Outlet Temperature	°C	80
Maximum Working Pressure	bar	8

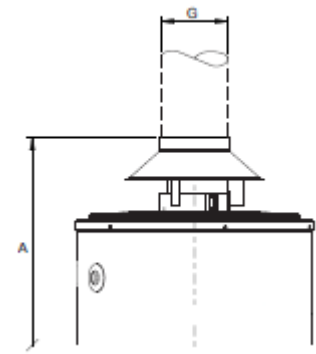

Standard draft diverter

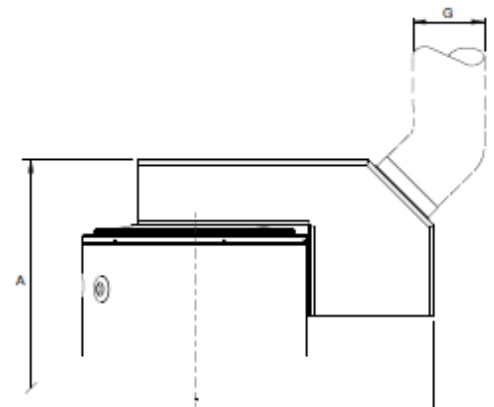

Alternative draft diverter type 1

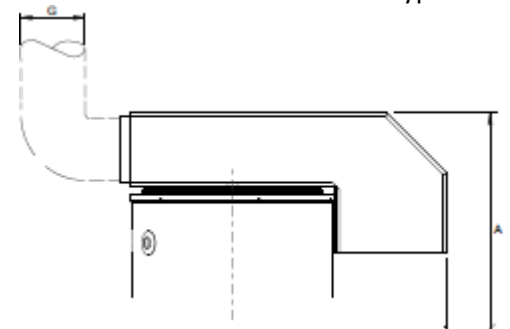

Alternative draft diverter type 2

Charger Low NOx water heaters must be installed and maintained in line with the Installation Commissioning and Maintenance Instructions which are available on the Literature & Downloads section of www.lochinvar.ltd.uk

Particular attention should be made to:-

- Dimensions and clearances
- Vented and Unvented installation requirements
- maintenance

ErP and Warranty

ErP Data including Product Fiche and Energy Labels where applicable and Warranty information are also available at www.lochinvar.ltd.uk