

TECHNICAL PRODUCT SUBMITTAL

LBT3000 THERMAL STORE



LBT3000


| EFFICIENCY DATA-Part L2 | |
|--------------------------------------|---------|
| Insulation Thickness | mm |
| Insulation Type | |
| Heat Loss | kWh/24h |
| EFFICIENCY DATA ErP AND ENERGY LABEL | |
| Ecodesign Energy Label rating | |
| Standing Loss | W |
| GENERAL DATA | |
| Storage Capacity | litres |
| Weight Empty | kg |
| Weight Full and Insulated | kg |
| Maximum Vessel Pressure | bar |
| Minimum Vessel Temperature | °C |
| Maximum Vessel Temperature | °C |

| |
|--------------|
| 100 |
| Polyethylene |
| n/a |
| n/a |
| n/a |
| 3000 |
| 340 |
| 3340 |
| 6 |
| -10 |
| 90 |

The LBT Thermal store must be installed and maintained in line with the Installation Commissioning and Maintenance Instructions which are available on the Literature & Downloads section of www.lochinvar.ltd.uk

ErP and Warranty

ErP Data including Product Fiche and Energy Labels where applicable and Warranty information are also available at www.lochinvar.ltd.uk

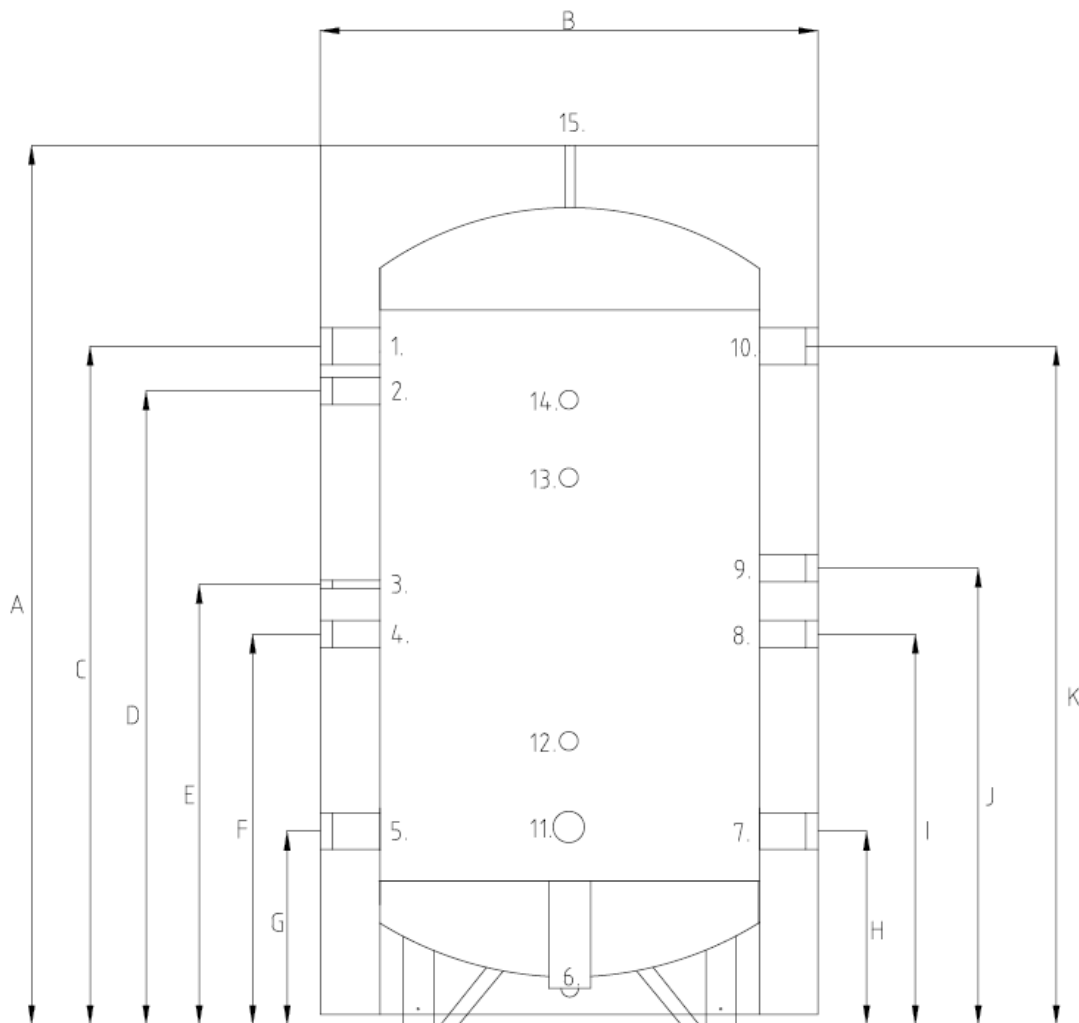

TECHNICAL PRODUCT SUBMITTAL

LBT3000 THERMAL STORE



| No | Description | Unit | LBT2000 | LBT2500 | LBT3000 | LBT4000 | LBT5000 |
|----|--|------|---------|---------|---------|---------|---------|
| A | Total Height (with insulation) | mm | 2565 | 2360 | 2860 | 2930 | 2970 |
| B | Diameter of Water Heater (with insulation) | mm | 1320 | 1470 | 1470 | 1620 | 1820 |
| C | Height of Heating system flow connection | mm | 2105 | 1865 | 2365 | 2390 | 2400 |
| D | Height of Auxiliary connection | | 1955 | 1615 | 2115 | 2140 | 2150 |
| E | Height of Sensor connection | mm | 1450 | 1255 | 1755 | 1780 | 1790 |
| F | Height of Auxiliary connection | mm | 1345 | 1005 | 1505 | 1530 | 1540 |
| G | Height of Heating system return connection | mm | 505 | 565 | 565 | 590 | 600 |
| H | Height ASHP Return connection | mm | 505 | 565 | 565 | 590 | 600 |
| I | Height of Auxiliary connection | mm | 1180 | 1150 | 1365 | 1390 | 1400 |
| J | Height of Auxiliary connection | mm | 1380 | 1315 | 1565 | 1590 | 1600 |
| K | Height of ASHP flow connection | mm | 2105 | 1865 | 2365 | 2390 | 2400 |
| A | Height of AAV Connection | mm | 2565 | 2360 | 2860 | 2930 | 2970 |

| No | Description | Unit | LBT2000 | LBT2500 | LBT3000 | LBT4000 | LBT5000 |
|----|----------------------------------|------|---------|---------|---------|---------|---------|
| 1 | Connection Heating System Flow | BSP | 3" | 4" | 4" | 4" | 4" |
| 2 | Connection Tank body | BSP | 2" | 2" | 2" | 2" | 2" |
| 3 | Connection Sensor Point | BSP | ½" | ½" | ½" | ½" | ½" |
| 4 | Connection Tank body | BSP | 2" | 2" | 2" | 2" | 2" |
| 5 | Connection Heating System Return | BSP | 3" | 4" | 4" | 4" | 4" |
| 6 | Connection Drain | BSP | 2" | 2" | 2" | 2" | 2" |
| 7 | Connection ASHP Return | BSP | 3" | 4" | 4" | 4" | 4" |
| 8 | Connection Tank Body | BSP | 2" | 2" | 2" | 2" | 2" |
| 9 | Connection Tank Body | BSP | 2" | 2" | 2" | 2" | 2" |
| 10 | Connection ASHP Flow | BSP | 3" | 4" | 4" | 4" | 4" |
| 11 | Connection Immersion heater | BSP | 2" | 2" | 2" | 2" | 2" |
| 12 | Connection Sensor Point | BSP | ½" | ½" | ½" | ½" | ½" |
| 13 | Connection Sensor Point | BSP | ½" | ½" | ½" | ½" | ½" |
| 14 | Connection Sensor Point | BSP | ½" | ½" | ½" | ½" | ½" |
| 15 | Connection Air Vent | BSP | 2" | 2" | 2" | 2" | 2" |