

# EFB

WALL HUNG GAS FIRED CONDENSING BOILERS

## Cascade pipework headers

Installation, Commissioning, User and  
Maintenance instructions

### MODELS

EFB85  
EFB105  
EFB125  
EFB155





# Table of Contents

|  |           |
|--|-----------|
| <b>1. INTRODUCTION.....</b>  | <b>4</b>  |
| <b>2. INSTALLATION PROCEDURE CASCADE CONFIGURATION .....</b>           | <b>5</b>  |
| <b>3. CALCULATE DIMENSIONS AND SPACE OF CASCADE CONFIGURATION.....</b> | <b>6</b>  |
| <b>4. EXPLANATION OF PARTS AND GROUPS.....</b>                         | <b>9</b>  |
| <b>5. CONNECTING SETS.....</b>   | <b>10</b> |
| <b>6. HYDRAULIC AND GAS HEADER GROUP .....</b>                         | <b>11</b> |
| 6.1 Headers .....  | 11        |
| 6.2 Support beam and support brackets .....                            | 11        |
| 6.3 Headers and connecting sets .....                                  | 12        |
| <b>7. MOUNTING THE FRAME.....</b>                                      | <b>13</b> |
| 7.1 Frame elements.....  | 13        |
| 7.2 Procedure for mounting the frame.....                              | 14        |
| <b>8. MOUNTING THE GAS HEADER .....</b>                                | <b>15</b> |
| <b>9. MOUNTING THE BOILERS ON THE FRAME.....</b>                       | <b>16</b> |
| <b>10. MOUNTING THE HYDRAULIC GROUP AND THE CONNECTING SETS .....</b>  | <b>17</b> |
| <b>11. MOUNTING THE LOW LOSS HEADERS.....</b>                          | <b>18</b> |
| <b>12. DETERMINE THE MANAGING AND DEPENDANT BOILERS .....</b>          | <b>19</b> |
| <b>13. COMPLETE THE MECHANICAL INSTALLATION .....</b>                  | <b>19</b> |
| <b>14. MOUNT THE FLUE GAS AND AIR SUPPLY SYSTEMS.....</b>              | <b>20</b> |
| 14.1 Individual flue systems .....                                     | 20        |
| 14.2 Common flue system .....  | 20        |
| <b>15. SET PARAMETERS .....</b>  | <b>21</b> |
| <b>16. COMMISSIONING THE CASCADE CONFIGURATION.....</b>                | <b>21</b> |
| <b>17. ACCESSORIES .....</b>   | <b>22</b> |
| <b>18. REFERENCES.....</b>   | <b>22</b> |
| 18.1 List of figures .....   | 22        |
| 18.2 List of tables.....   | 22        |
| <b>19. APPENDIX A – CASCADE PARTS .....</b>                            | <b>23</b> |

# 1. Introduction

This manual has been written for:

- The installer
- System design engineers
- Service engineers



## READ AND UNDERSTAND THE INSTRUCTIONS

**Read and fully understand all instructions before attempting to operate maintain or install the unit.**

This Cascade manual is intended for the EFB boiler series as manufactured by Lochinvar Limited.

The boilers can be combined in one cascade configuration. This ensures that the power required can always be achieved. Since several boilers are combined this allows for a large modulation range accurately matching boiler output to system load.

Lochinvar Limited can supply standard cascade systems with mounting frame, piping and low loss headers for up to six boilers depending on the range. Larger amounts of boilers in a cascade combination are possible but require a dedicated system which must be designed separately.

The software allows for combining of up to 16 EFB-boilers in a single cascade installation.

This document will offer you a general procedure for the complete installation of a cascade configuration. For specific details regarding connections, parameters, venting, etc. see the Installation, Commissioning, User and Maintenance instructions for the boilers available at [www.lochinvar.ltd.uk](http://www.lochinvar.ltd.uk).



**Figure 1.1 Typical cascade configuration**


## 2. Installation procedure cascade configuration

In order to completely install a cascade configuration of two or more boilers, the following procedure should be observed:


1. **Calculate the total required amount of power for the cascade configuration and determine the number of boilers necessary in the cascade configuration to achieve the required power.**
2. **Determine the dimensions of the cascade set and the required space at the planned location.**  
This is described in detail in chapter 3.
3. **Mount the frame.**  
This is described in detail in chapter 7.
4. **Mount the gas header.**  
This is described in detail in chapter 8.
5. **Mount the boilers on the frame.**  
This is described in detail in chapter 9.
6. **Mount the hydraulic group and the connecting sets.**  
This is described in detail in chapter 10.
7. **Mount the low loss header.**  
This is described in detail in chapter 11.
8. **Determine which boiler is managing and which are depending.**  
This is described in detail in chapter 12.
9. **Complete the mechanical installation of the cascade configuration.**  
This is discussed in chapter 13.
10. **Mount the flue gas and air supply systems.**  
This is discussed in chapter 14.
11. **Set the parameters in the software by means of the controller of each boiler.**  
This is discussed in chapter 15.
12. **Commission the cascade installation.**  
This is discussed in chapter 16.

### 3. Calculate dimensions and space of cascade configuration

This chapter explains how to determine the dimensions of the cascade configuration and how much space is required in the room where the cascade configuration will be installed.

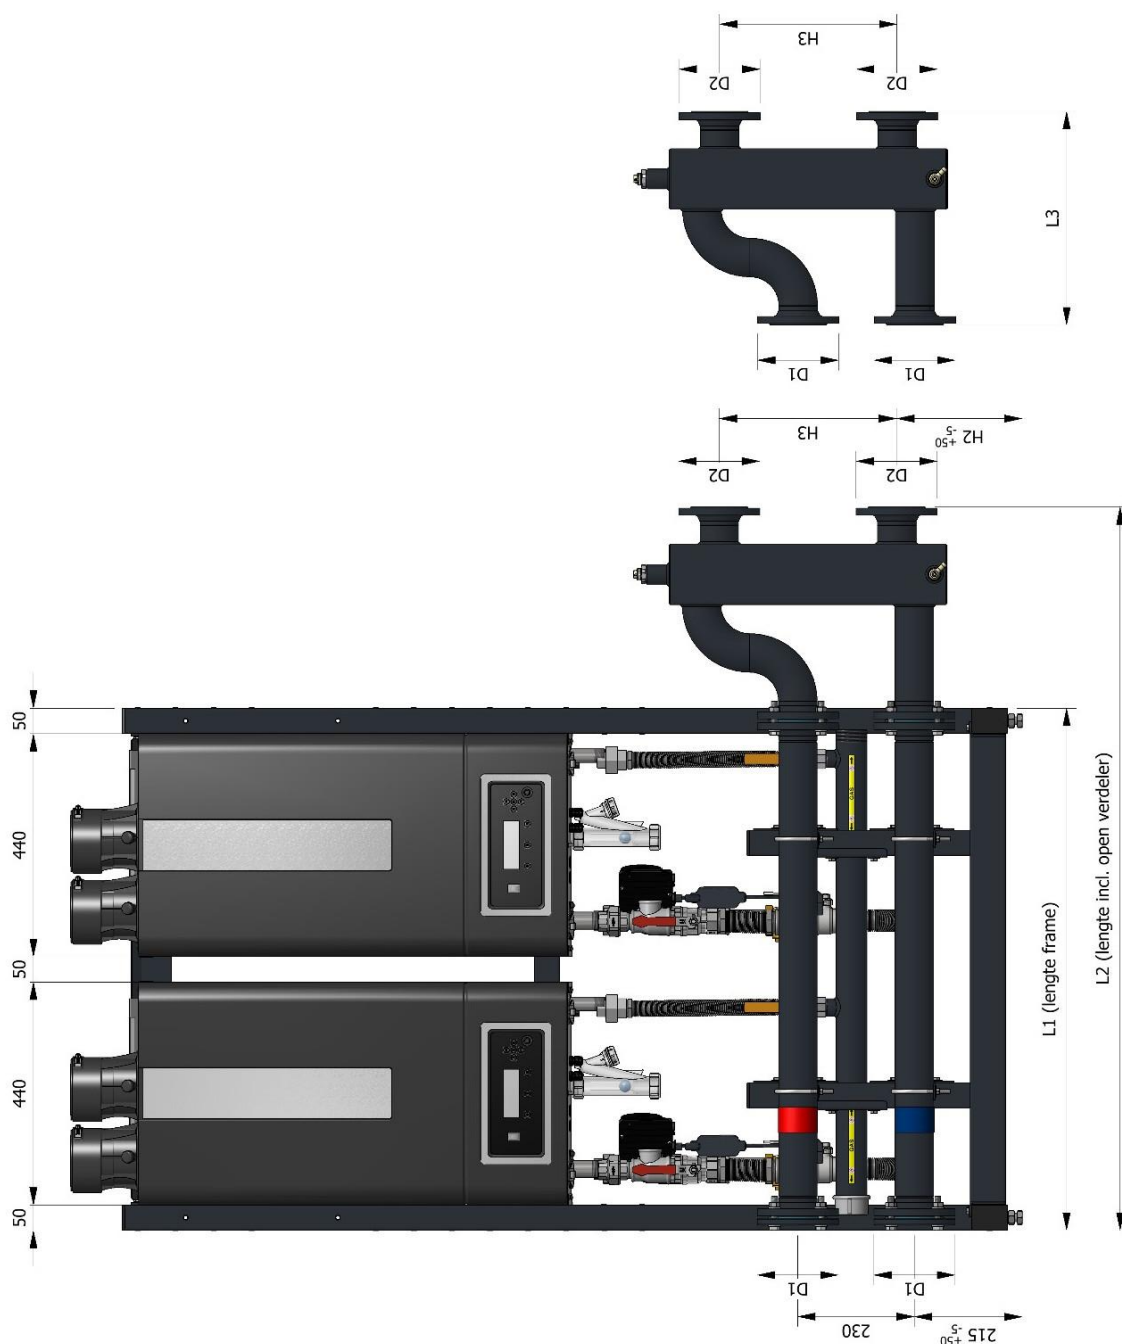

**Figure 3.1 Dimensions front view**

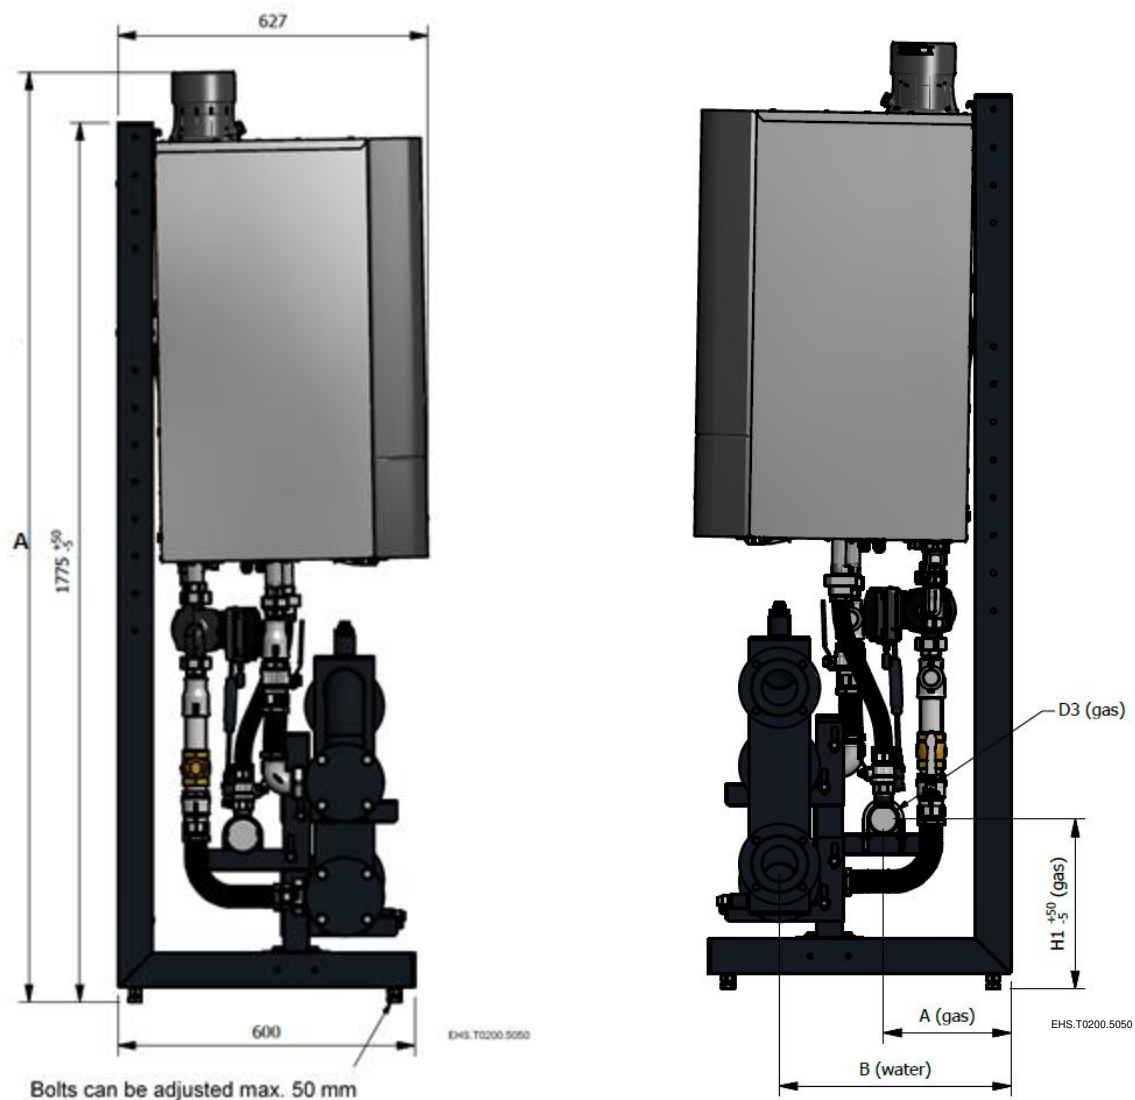

**Figure 3.2 Dimensions: side views**

| Height at A |           |            |
|-------------|-----------|------------|
| Model       | Twin-pipe | Concentric |
| EFB85       | 1876mm    | 1821mm     |
| EFB105      | 1876mm    | 1821mm     |
| EFB125      | 1876mm    | 1821mm     |
| EFB155      | 1916mm    | n/a        |

After you have determined which cascade configuration will be applied and therefore how many boilers must be combined in the cascade configuration, the next step is to determine the total dimensions of the cascade configuration and the space required for the cascade configuration.

Figure 3.1 and Figure 3.2 show a schematic representation of a cascade configuration. The dimensional references in this figure (L1-L3, H1-H3, D1-D3, A, B) correspond with the dimensional references in the tables below.

#### EXAMPLES

A cascade configuration of 275 kW is required, which will consist of 2 boilers, refer to Table 3.1 for the dimensions of the cascade configuration. The table shows that frame length for this configuration is 1030 mm and the total length including the low loss header is 1428 mm.

All these dimensions have to be taken into account when determining the space required for placing the cascade configuration.

| Number of boilers<br>(up to 360 kW) | 2 boilers        | 3 boilers        | 4 boilers        |
|-------------------------------------|------------------|------------------|------------------|
| L1 (length frame)                   | 1030             | 1520             | 2010             |
| L2 (total length incl. header)      | 1428             | 1918             | 2408             |
| L3 (length low loss header)         | 422              | 422              | 422              |
| H1 (height gas)                     | 308              | 308              | 308              |
| H2 (height header coupling)         | 248              | 248              | 248              |
| H3 (height couplings)               | 350              | 350              | 350              |
| D1 (header connection size)         | DN 65 PN6 (2½ “) | DN 65 PN6 (2½ “) | DN 65 PN6 (2½ “) |
| D2 (header connection size)         | DN 65 PN6 (2½ “) | DN 65 PN6 (2½ “) | DN 65 PN6 (2½ “) |
| D3 (gas connection size)            | R 2”             | R 2”             | R 2”             |
| A (gas)                             | 253              | 253              | 253              |
| B (headers)                         | 459              | 459              | 459              |

**Table 3.1 Dimensions EFB cascade up to 360 kW**

| Number of boilers<br>(360 up to 540 kW) | 3 boilers       | 4 boilers       |
|---|-----------------|-----------------|
| L1 (length frame)                       | 1520            | 2010            |
| L2 (total length incl. header)          | 1938            | 2473            |
| L3 (length low loss header)             | 487             | 487             |
| H1 (height gas)                         | 308             | 308             |
| H2 (height header coupling)             | 257             | 257             |
| H3 (height couplings)                   | 380             | 380             |
| D1 (header connection size)             | DN 80 PN6 (3 “) | DN 80 PN6 (3 “) |
| D2 (header connection size)             | DN 80 PN6 (3 “) | DN 80 PN6 (3 “) |
| D3 (gas connection size)                | R 2”            | R 2”            |
| A (gas)                                 | 253             | 253             |
| B (headers)                             | 466             | 466             |

**Table 3.2 Dimensions EFB cascade 360 up to 540 kW**

| Number of boilers<br>(540 to 930 kW) | 4 boilers        | 5 boilers        | 6 boilers        |
|--------------------------------------|------------------|------------------|------------------|
| L1 (length frame)                    | 2010             | 2500             | 2990             |
| L2 (total length incl. header)       | 2614             | 3104             | 3594             |
| L3 (length low loss header)          | 628              | 628              | 628              |
| H1 (height gas)                      | 327              | 327              | 327              |
| H2 (height header coupling)          | 272              | 272              | 272              |
| H3 (height couplings)                | 420              | 420              | 420              |
| D1 (header connection size)          | DN 100 PN6 (4 “) | DN 100 PN6 (4 “) | DN 100 PN6 (4 “) |
| D2 (header connection size)          | DN 100 PN6 (4 “) | DN 100 PN6 (4 “) | DN 100 PN6 (4 “) |
| D3 (gas connection size)             | DN 80 (3”)       | DN 80 (3”)       | DN 80 (3”)       |
| A (gas)                              | 253              | 253              | 253              |
| B (headers)                          | 482              | 482              | 482              |

**Table 3.3 Dimensions EFB cascade 540 to 930 kW**



## 4. Explanation of parts and groups

Each cascade configuration exists of the following parts and groups:

1. The number of boilers as selected.
2. The frame group (with locking plates) as determined by the number of boilers.
3. An external pump for each boiler. (either supplied by the installer or by Lochinvar at extra cost)
4. Connecting sets to connect the boilers to the hydraulic and gas header groups. Each connecting set contains one gas, one supply and one return pipe. More details can be found in chapter 5.
5. Hydraulic and gas header group, existing of 1 gas, 1 supply and 1 return header, including all mounting and connecting parts. More details can be found in chapter 6.
6. Low-loss header to connect the hydraulic group to the heating installation.


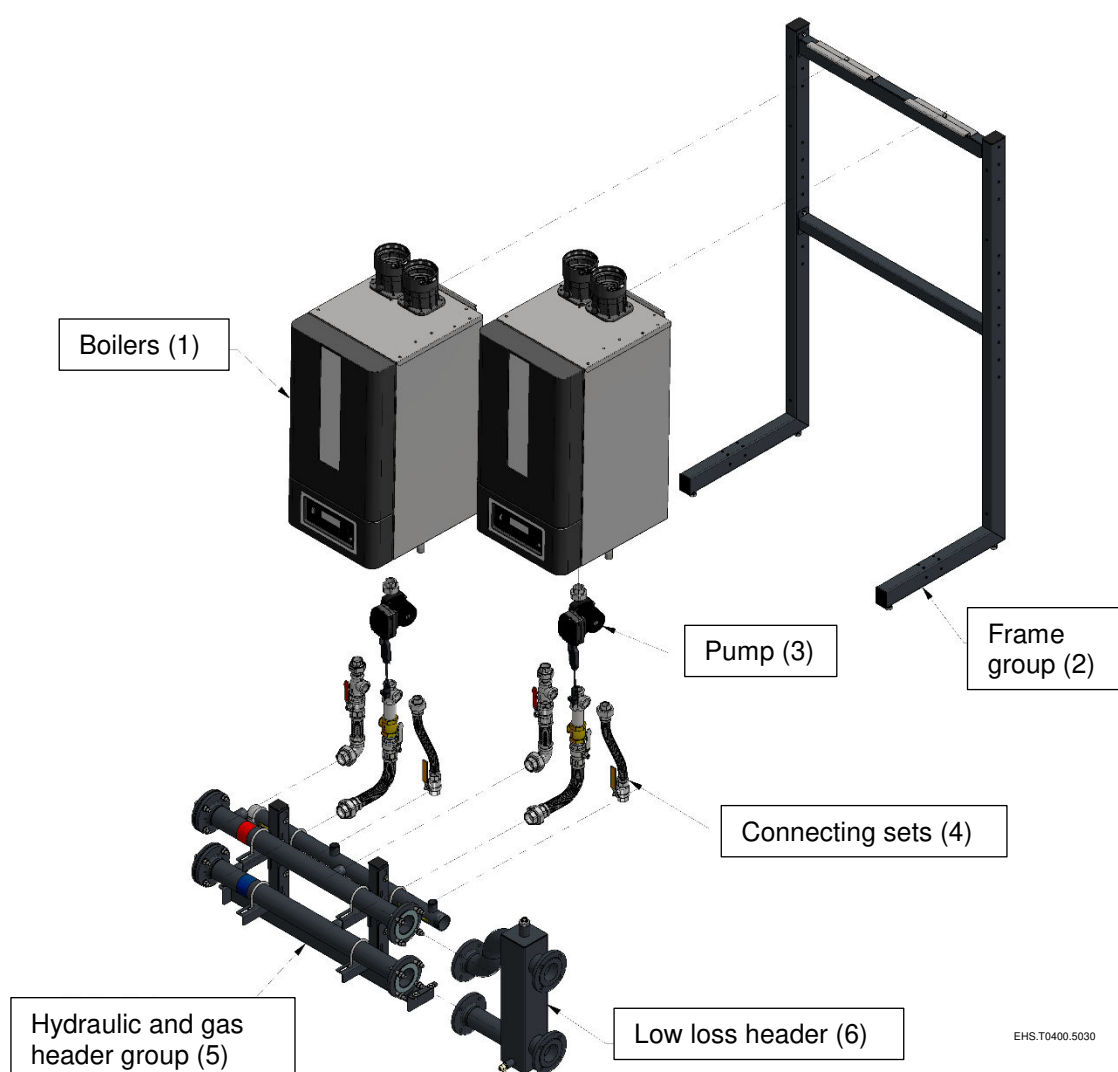



Figure 4.1 Cascade parts and groups

## 5. Connecting sets


### Supply connecting set

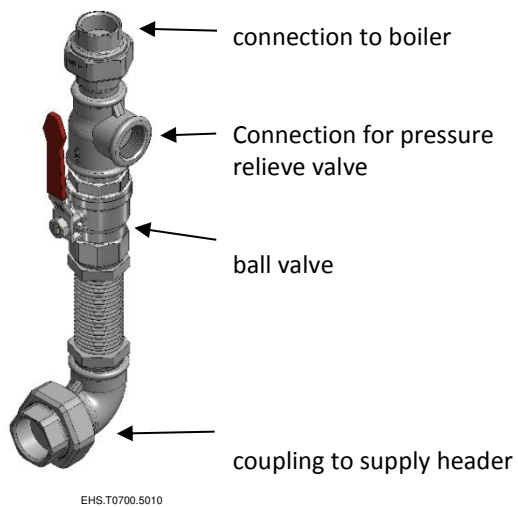

### Gas connecting set

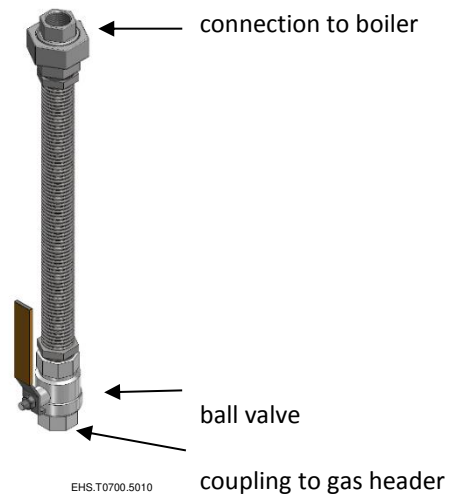

### Return connecting set with external pump

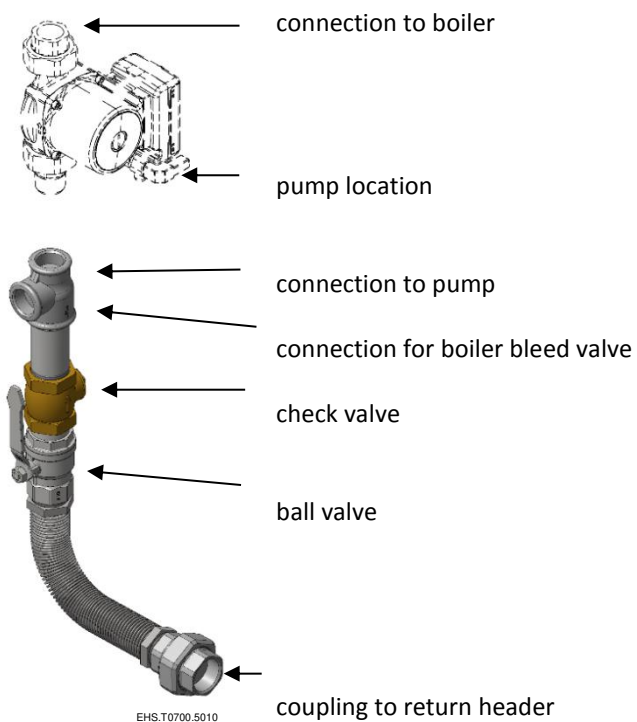

**Figure 5.1 Connecting sets**


The gas connecting set should be connected to the gas connection on the boiler.

The supply connecting set must be connected to the boiler supply connection (front connection on the boiler) and the return connecting set (longest) to the boiler return connection (back connection on the boiler).

The open connection in the supply connecting set is meant for a pressure relief valve, and the open connection in the return connecting set is to be used for a boiler bleeding valve.

## 6. Hydraulic and gas header group

### 6.1 Headers

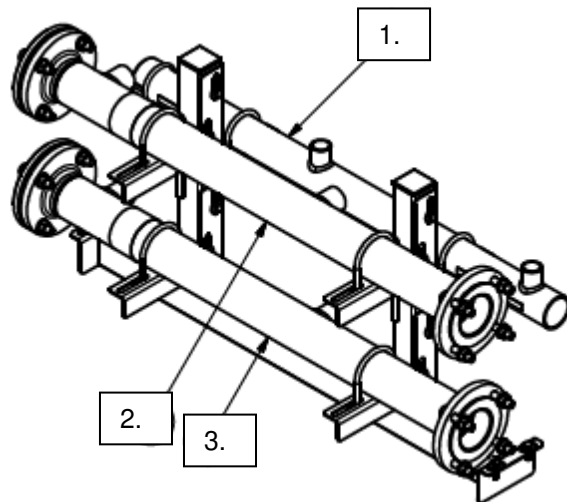

1. Gas header (yellow marking)
2. Supply header (red marking)
3. Return header (blue marking)

Figure 6.1 Parts hydraulic and gas header group

### 6.2 Support beam and support brackets

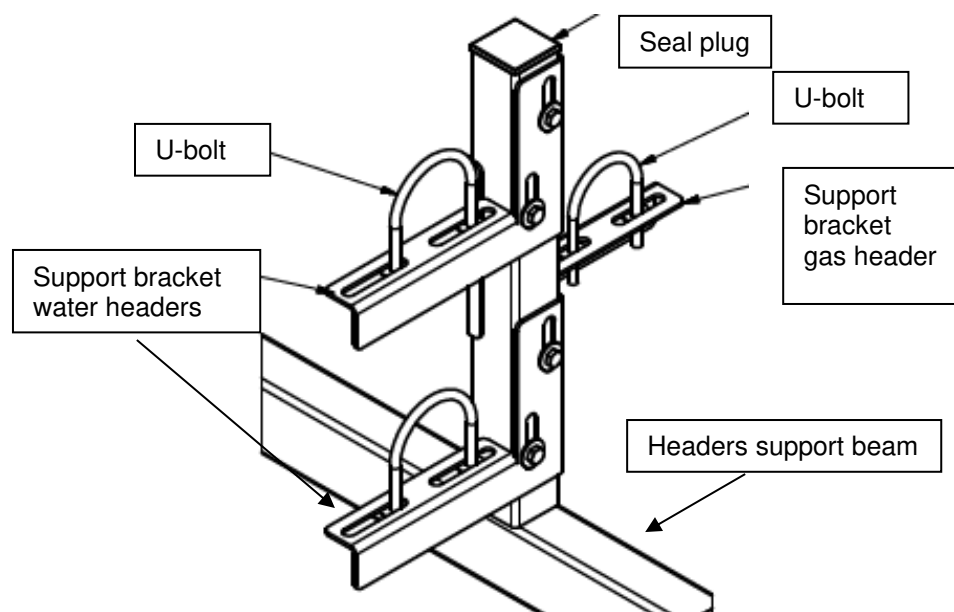


Figure 6.2 Headers support beam and support brackets

6.3 Headers and connecting sets

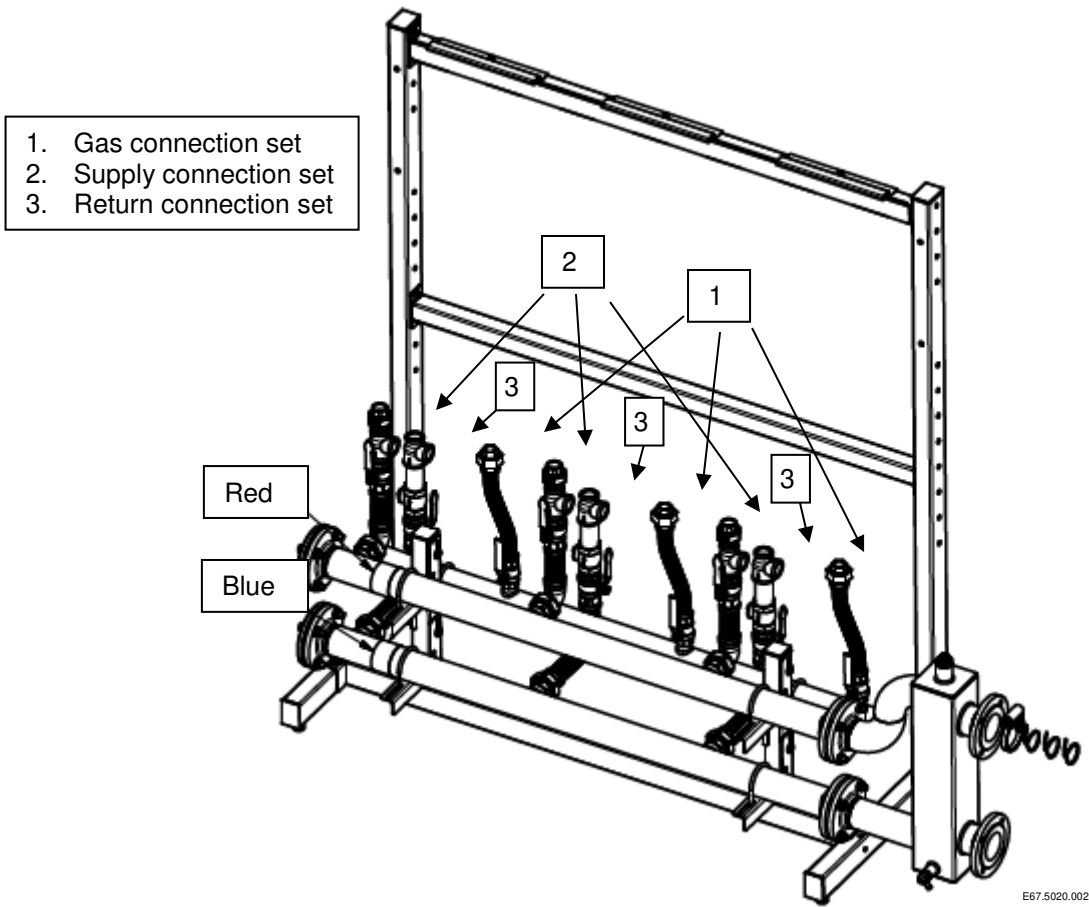


Figure 6.3 Headers and connecting sets

Variant sizes

Depending on the cascade configuration the headers come in the following size varieties:

| Header                           | Varieties           |
|----------------------------------|---------------------|
| Gas header                       | DN50 / DN80         |
| Water header (supply and return) | DN65 / DN80 / DN100 |

See also Table 3.1, Table 3.2 and Table 3.3.

## 7. Mounting the frame

### 7.1 Frame elements

The first part of the actual installation of the cascade configuration is assembling the frame on which the boilers will be hung.

The basic frame exists of the following elements:

- L-shaped stands
- Top beam
- In-between beam (middle beam)
- Mounting material (bolts, washers)

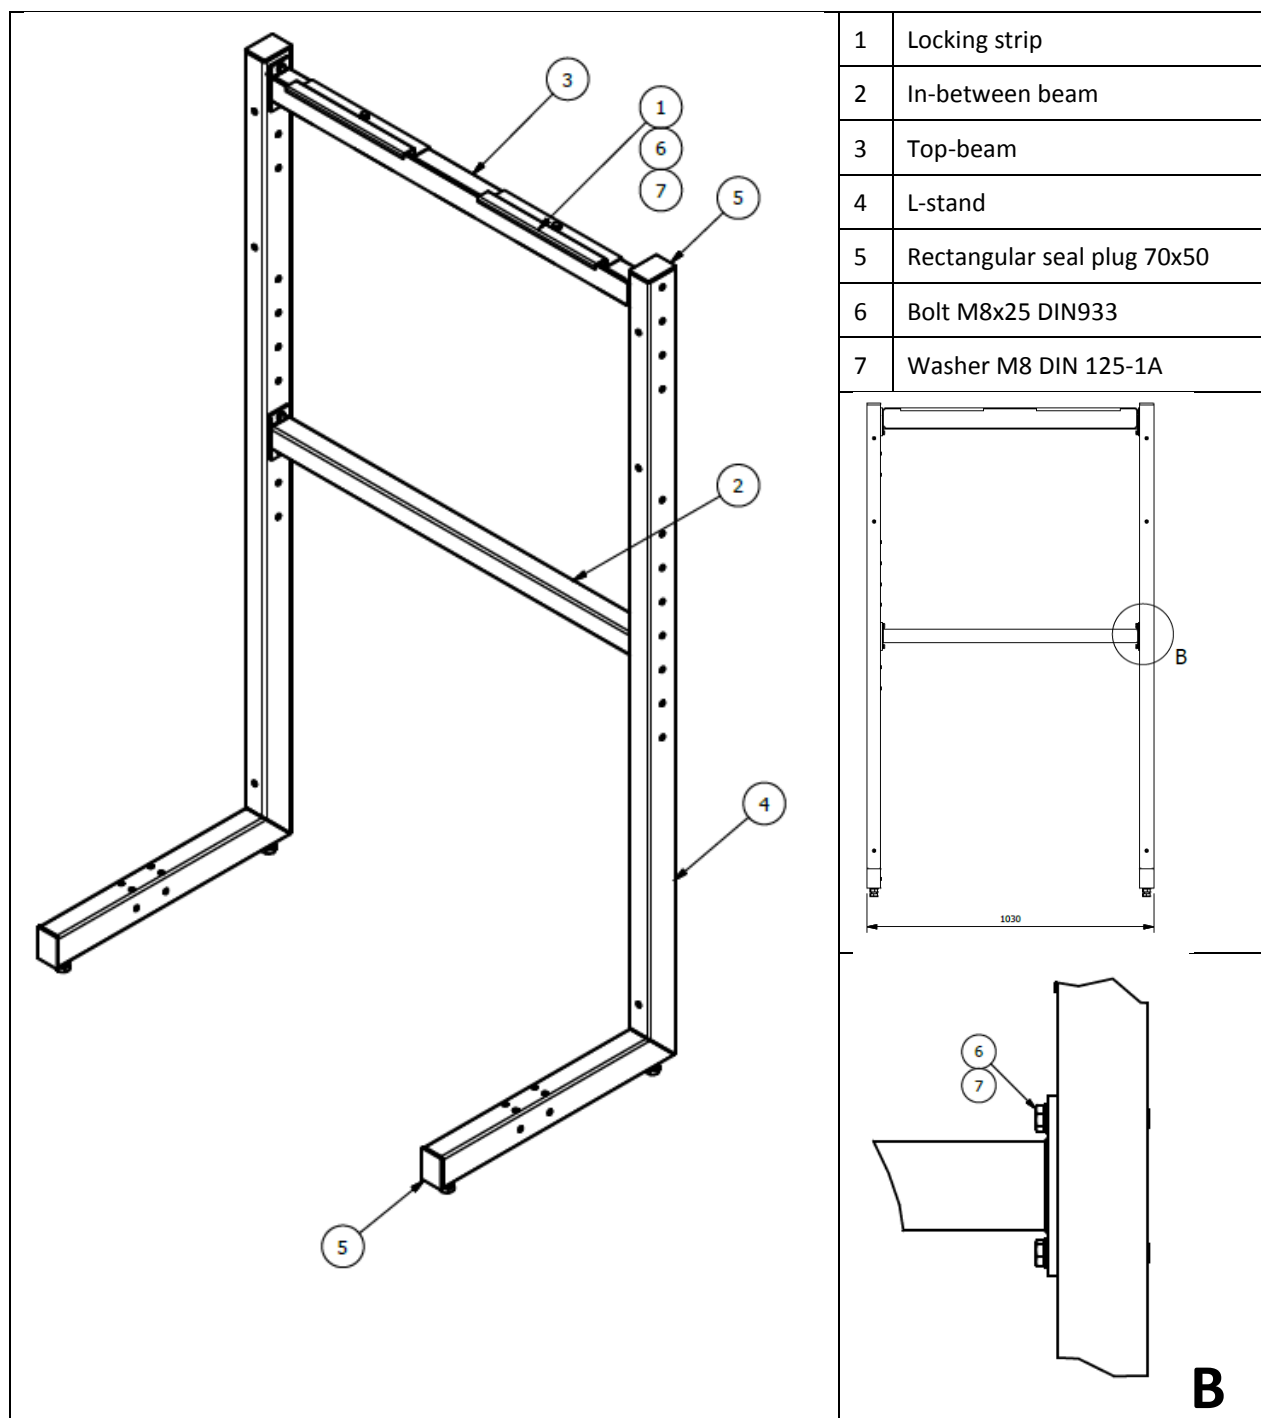


Figure 7.1 Frame elements

The number of elements to be mounted depends on the number of boilers which have to be combined.

| # Boilers |   | # L-stands | # Top beams | # In-between beams | # Frame braces | Width beams |
|-----------|---|------------|-------------|--------------------|----------------|-------------|
| 1*        |   | 2          | 1           | 1                  | 1              | 440 mm      |
| 2         |   | 2          | 1           | 1                  | 1              | 930 mm      |
| 3         |   | 2          | 1           | 1                  | 1              | 1420 mm     |
| 4         |   | 3          | 2           | 2                  | 2              | 930 mm      |
| 5         | consists of a 2-boiler frame and a 3-boiler frame | 3          | 1           | 1                  | 1              | 930 mm      |
|           |   |            | 1           | 1                  | 1              | 1420 mm     |
| 6         | option 1  | 3          | 2           | 2                  | 2              | 1420 mm     |
|           | option 2  | 4          | 3           | 3                  | 3              | 930 mm      |

\* A frame can also be mounted for a single boiler, although a 1 boiler configuration does not fall within the cascade scope of this manual.

**Table 7.1 Frame elements per cascade set**



**Attention!**

Each set for the required cascade configuration will contain the exact amount of material required for the cascade configuration type ordered.

## 7.2 Procedure for mounting the frame

See also Figure 7.1.

To mount the frame, subsequently carry out the steps in the following procedure:

1. Check after unpacking that all parts are actually present.
2. Mount the in-between beam(s) between the L-stands.  
Ensure that the beam's flange hole falls over the raised edge of the L-stand connection hole.  
Mount the beam(s) loosely; do not yet tighten the bolts.
3. Mount the top beam(s) between the L-stands.  
Ensure that the beam's flange hole falls over the raised edge of the L-stand connection hole.  
Mount the beam(s) loosely; do not yet tighten the bolts.
4. Level the L-stands, both vertically and horizontally.  
Use a level and the adjustment bolts on the bottom of the L-stands.



**Attention!**

The frame must be levelled tension-free.

So do not tighten bolts or mount boilers before the frame has been levelled.



**Attention!**

After mounting the frame, the frame must be braced or mounted to the wall or ceiling to prevent the frame and boilers from wobbling.

Check the local building regulations for the relevant requirements

## 8. Mounting the gas header



**Attention!**

All lines/piping must be mounted free of tension. The weight of all the components should be supported separately from the boiler so there is no force on the connections.



**Attention!**

During mounting of the gas header group it is very important that the position of the support beam as well as the support brackets of the headers allow for some play (tolerance) for a neat installation. After finishing the installation, the support beam and brackets can be tightened.

1. Mount the support beam(s) for the hydraulic and gas header group loosely between the legs of the L-stands.
2. Mount the support brackets for the gas header at nominal height. See also Figure 6.2.
3. Place the gas header(s) on the support brackets and fasten it (them) loosely with the U-bolts. Make sure that the connections for the corresponding connecting sets are at the upper side of the header(s).
4. Next mount the boilers on the frame. See chapter 9.

## 9. Mounting the boilers on the frame

1. Before mounting the boiler on the frame, ensure that the frame is level both horizontally and vertically. If necessary adjust with the adjusting bolts on the lower side of the frame (see Figure 9.1).
2. Hang the boilers on the frame.
3. Align the boilers with the L-stand in such a way that there is an exact 50 mm gap between the boilers.
4. Lock the suspension bracket with the locking strip to prevent the boiler from falling off the bracket (see drawing).
5. Make sure that the boiler is at the right position (near level).  
The boilers must hang backwards slightly ( $1^\circ \pm 0.5^\circ$ ). If necessary, adjust with the adjusting bolts on the lower rear side of the back panel (see Figure 9.1). When the adjusting bolts are **not** sufficient, the space behind the bolts needs to be filled to achieve the correct position.



### Attention!

The boiler must never lean forward in the mounted position.

6. Next mount the hydraulic group and connecting sets. See chapter 10.

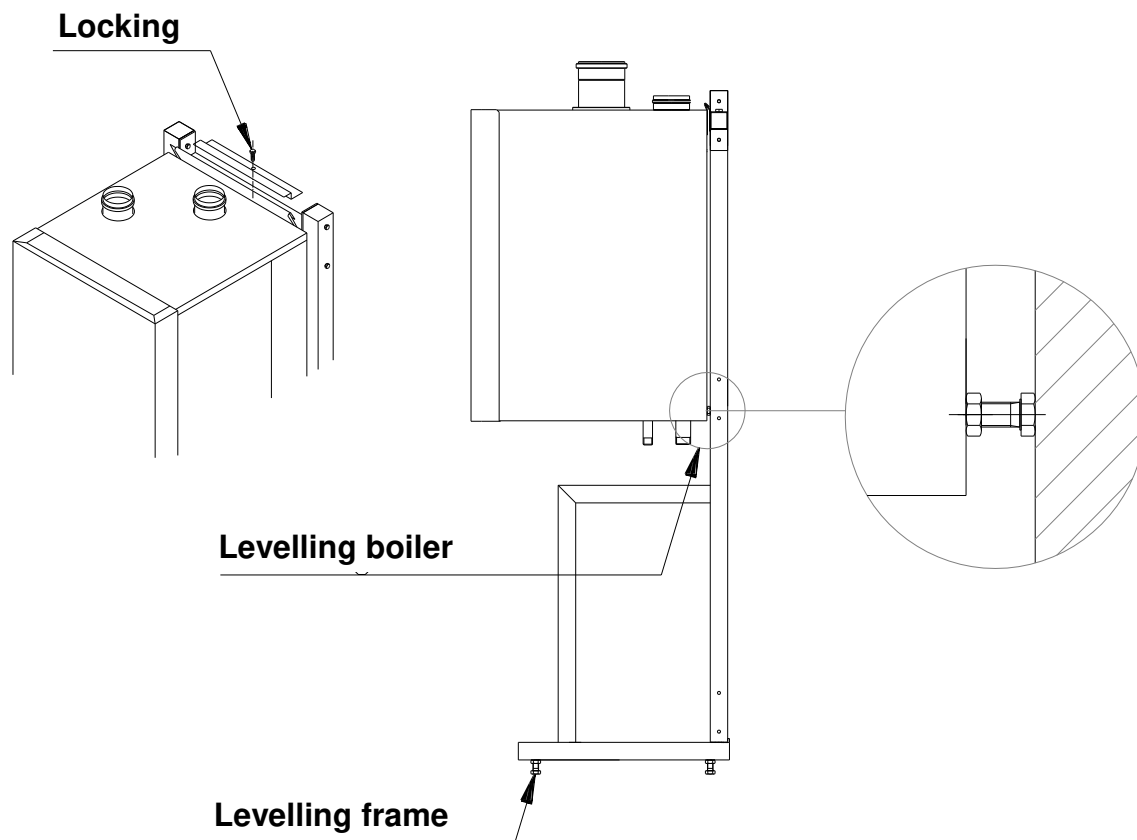


Figure 9.1 Mounting details



## 10. Mounting the hydraulic group and the connecting sets

Mount the Hydraulic kits and connecting sets after fitting the boiler first.



### Attention!

All lines/piping must be mounted free of tension. The weight of all the components should be supported separately from the boiler so there is no force on the connections.



### Attention!

During mounting of the hydraulic and gas header group it is very important that the position of the support beam as well as the support brackets of the headers allow for some play (tolerance) for a neat installation. After finishing the installation, the support beam and brackets can be tightened.

1. Mount the support brackets for the return header at nominal height. See also Figure 6.2.
2. Place the return header(s) (bottom water header / blue) on the support brackets and fasten it (them) loosely with the U-bolts. Make sure that the connections for the corresponding connecting sets are at the back of the header.
3. Mount the connecting sets for the return header. See also Figure 6.3.



### Attention!

An external pump (to be ordered separately) must be mounted between the return connecting set and the boiler.

Required for this are:

- pump supplied with 2 flat-seal two-part couplings;
  - 1 flat-seal coupling for connection to boiler (inside thread / female thread)
  - 1 flat-seal coupling for connection to connecting set (outside thread / male thread)
- a. Fit the flat-seal couplings to the boiler and to the connecting set.
  - b. Mount the pump to the boiler; pay attention to its orientation.
  - c. Mount the connecting set to the pump; pay attention to its orientation.
  - d. Bend the flexible part of the return connecting set into a smooth bend.
  - e. Fit the connecting set to the return header (conical three-part coupling). Fit the loose part to the header and then fasten the coupling.
4. Mount the support brackets for the supply header. See also Figure 6.2.
  5. Place the supply header(s) (top water header / red) on the support brackets and fasten it (them) loosely with the U-bolts.
  6. Mount the connecting sets for the supply header. See also Figure 6.3.  
The connecting set has a three-part coupling for the connection to the boiler.
    - a. Fit the loose part of the three-part coupling to the boiler.
    - b. Fit the connecting set to the coupling.
    - c. Fit the connecting set to the supply header (conical three-part coupling). Fit the loose part to the header and then fasten the coupling.
  7. Fit the gas connecting sets to the boiler and to the gas header.
  8. When all parts are mounted correctly and are free of tension, fasten all couplings, bolts and U-bolts.
  9. Next mount the low loss header. See chapter 11.

## 11. Mounting the low loss headers

After mounting the hydraulic and gas header group and the connecting sets to the boilers, the low loss header must be mounted to the supply and return headers.

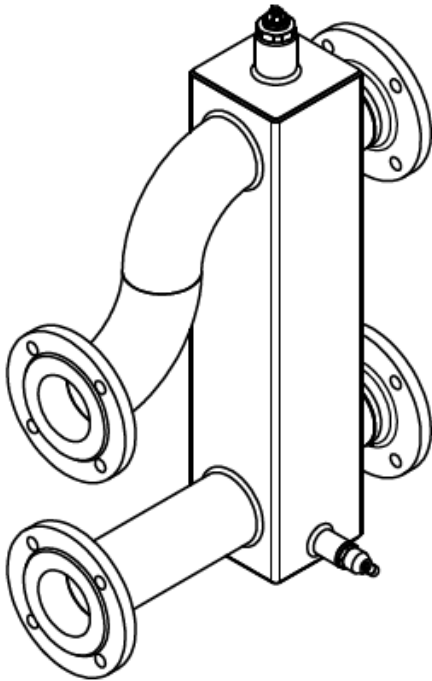


Figure 11.1 Low loss header

Depending on the configuration of the cascade setup, one of the following low loss headers can be mounted:

| Type   | Size | Used for                              | Article number | Size          |
|--------|------|---------------------------------------|----------------|---------------|
| DN 65  | 2,5" | Cascade installation up to 360 kW     | E68.0300.501   | 120 x 120 x 3 |
| DN 80  | 3"   | Cascade installation 360 up to 540 kW | E68.0300.502   | 140 x 140 x 4 |
| DN 100 | 4"   | Cascade installation 540 to 930 kW    | E68.0300.503   | 200 x 200 x 5 |

Table 11.1 Low loss header connection sizes

The low-loss header can be fitted on the right-hand side as well as on the left-hand side without making any alterations to the supplied parts. The gas connection can also be fitted on one of both sides, independent from the side chosen for the low loss header.

1. Mount the low loss header.  
It can be mounted on the right-hand or the left-hand side of the supply and return headers, whatever the best place for connecting the headers to the heating installation.
2. Fit the supplied flanges on the opposite end of the supply and return headers in order to block those ends.
3. Fit the supplied seal cap on the opposite end of the gas header in order to block that end.

## 12. Determine the managing and dependant boilers

Before completing the mechanical installation it is important to decide which boiler will be the managing boiler.

Any of the boilers can be assigned as managing boiler; all the other boilers in the cascade configuration have to be assigned as depending boilers.

When the CH supply temperature is based on an outdoor sensor, only one outdoor sensor is needed. This sensor is connected to the managing boiler and calculates the CH setpoint for the cascade system.

A cascade system can be used with a DHW indirect tank. A DHW circulator and sensor must be connected to the managing boiler.

All boilers in the cascade system have to be assigned a unique address. This is done in the parameters of each boiler.

How to assign unique addresses to boilers and how to manage the parameters required for the cascade configuration is described in detail in the chapter(s) about Cascading in the Installation & Service Manual of the EFB boiler series.

## 13. Complete the mechanical installation

After the previous instructions have been completed, the cascade configuration must be connected to the heating system and the mechanical installation of the cascade configuration must be completed with all other necessary parts and connections.

This may include:

- All valves
- Non-return valves
- Strainers
- Air separators
- Expansion vessel
- Overflow



### Attention!

The hydraulic piping of the Lochinvar Limited cascade systems already contains non-return valves underneath each boiler. When other hydraulic systems are used, non-return valves must be fitted in the return pipe of each boiler.

The Installation, Commissioning, User and Maintenance instructions of the EFB boiler series provides you with the necessary installation schemes and requirements to complete the installation.

In addition to the instructions from Installation, Commissioning, User and Maintenance instructions, it is imperative for the cascade configuration to:

- Complete all wiring of the boilers according to the boiler manual. For the system to work for cascade the communication busses must be parallel linked together.



### Attention!

Link all connections 10 to 10 and all connections 11 to 11, do not mix these.

Link connections 10 of the dependant boilers to 20 of the managing boiler, and connections 11 of the dependant boilers to 21 of the managing boiler.

For more information refer to the chapters on Electrical Installation and Cascade in the Installation, Commissioning, User and Maintenance instructions of the EFB boiler series. If no expansion vessel or overflow is fitted to the T-connection of the supply connecting set and/or return connecting set, the T-connection(s) must be blocked by fitting a cap or stopper on the T-connection(s) in question.

## 14. Mount the flue gas and air supply systems

After the cascade installation has been connected to the heating installation, the flue gas and air supply systems must be mounted in compliance with the applicable standards and regulations and in accordance with the instructions from Installation, Commissioning, User and Maintenance instructions of the EFB boiler series.

### 14.1 Individual flue systems

The individual flue systems must be mounted in compliance with the applicable standard and in accordance with the instructions from the Installation, Commissioning, User and Maintenance instructions of the EFB boiler series (**"Flue gas and air supply system"**).

For each boiler, the combined resistance of the individual flue gas and air inlet pipe can be calculated and checked with the maximum resistance allowed.

For resistance tables and example calculations we refer to the aforementioned chapter in the boiler manual.

### 14.2 Common flue system

A common flue system must be designed in accordance with EN 13384-2 "Chimney – Thermal and fluid dynamic calculation methods – Part 2: Chimneys serving more than one heating appliance."



**Attention!**

**Each boiler is fitted with a NRV to prevent flue gas recirculation in non-firing boilers.**



**Attention!**

**Consult a suitably qualified flue specialist when designing common flue systems**

## 15. Set parameters

Before commissioning the cascade installation, several parameters have to be changed in order to have the boilers operate in unison as a cascade configuration.

These parameters can be programmed on each boiler itself in the display of the boiler (so without the use of an external computer).

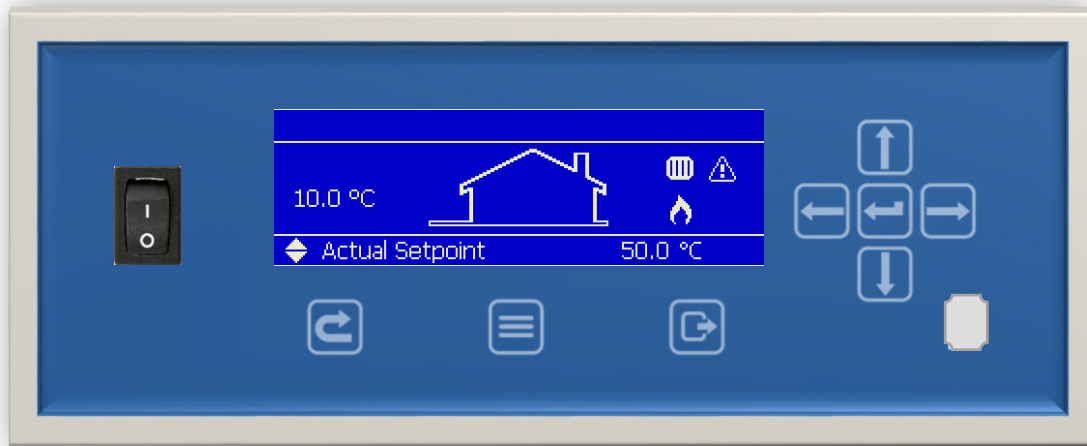


Figure 15.1 Boiler display

One of the boilers has been assigned as managing boiler; all the other boilers in the cascade configuration have been assigned as depending boilers (see chapter 12).

These depending boilers in the cascade system have to be assigned a unique address. This is set in the parameters of each boiler.

How to assign unique addresses to boilers and how to manage the parameters required for the cascade configuration is described in detail in the chapter(s) about Cascading in the Installation & Service Manual of the EFB boiler series.



### Attention!

Changes in parameters may only be carried out by a skilled installation/service engineer, who has had specific training for setting up the EFB boilers. He will be able to check whether the installation functions correctly after the parameter change has been done.

## 16. Commissioning the cascade configuration

To complete the cascade configuration, the installation must be commissioned. Commissioning is described in detail in the relevant chapter(s) of the Installation & Service Manual of the EFB boiler series.

After commissioning the total cascade configuration will act as one single boiler, switching boilers on and off, depending on the total load necessary to adjust and keep the supply temperature at the set value.

## 17. Accessories

To complete your cascade configuration the following accessories are available:

| Sensors |                            | Details     | Article nr. | Remarks  |
|---------|----------------------------|-------------|-------------|----------|
| 1       | OUTSIDE TEMPERATURE SENSOR | 12kOhm@25°C | LE04016585  | Optional |
| 2       | FLOW TEMPERATURE SENSOR    | 10kOhm@25°C | LE04016304  | Required |

Table 17.1 Accessories

## 18. References

### 18.1 List of figures


|  |    |
|--|----|
| Figure 1.1 Typical cascade configuration .....             | 4  |
| Figure 4.1 Dimensions front view .....                     | 6  |
| Figure 4.2 Dimensions: side views .....                    | 7  |
| Figure 5.1 Cascade parts and groups .....                  | 9  |
| Figure 6.1 Connecting sets .....                           | 10 |
| Figure 7.1 Parts hydraulic and gas header group .....      | 11 |
| Figure 7.2 Headers support beam and support brackets ..... | 11 |
| Figure 7.3 Headers and connecting sets .....               | 12 |
| Figure 8.1 Frame elements .....                            | 13 |
| Figure 10.1 Mounting details .....                         | 16 |
| Figure 12.1 Low loss header .....                          | 18 |
| Figure 16.1 Boiler display .....                           | 21 |

### 18.2 List of tables


|   |    |
|---|----|
| Table 4.1 Dimensions EFB cascade up to 360 kW .....     | 8  |
| Table 4.2 Dimensions EFB cascade 360 up to 540 kW ..... | 8  |
| Table 4.3 Dimensions EFB cascade 540 to 930 kW .....    | 8  |
| Table 8.1 Frame elements per cascade set .....          | 14 |
| Table 12.1 Low loss header connection sizes .....       | 18 |
| Table 18.1 Accessories .....                            | 22 |

## 19. Appendix A – Cascade Parts

The following drawings give an overview of parts used in a cascade configuration.

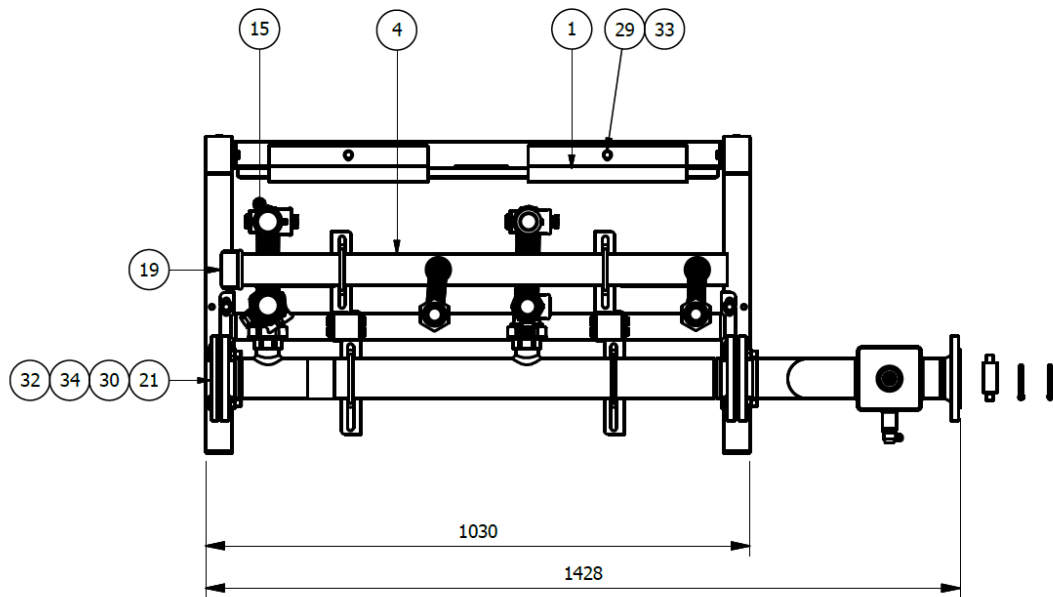

**Top view**

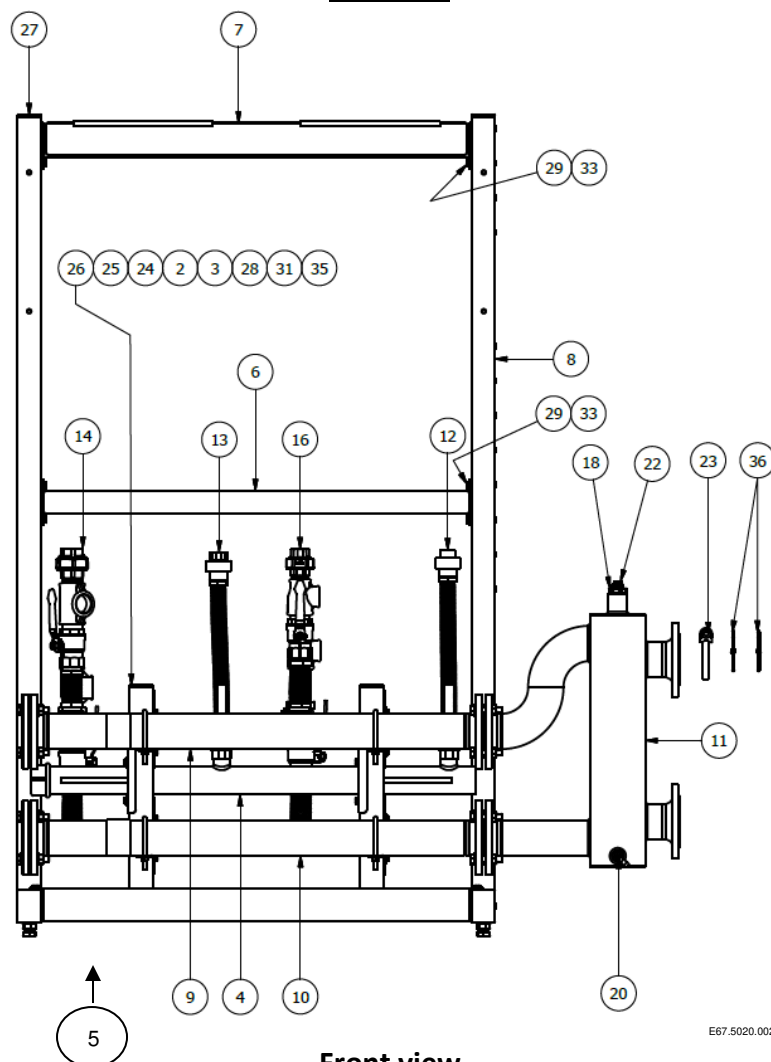

**Front view**

E67.5020.002

The exact amount for each part in the cascade configuration varies and depends on the cascade type and the number of boilers in the cascade set.

Furthermore, headers and connecting set couplings come in different sizes, depending on the cascade configuration (see Table 3.1, Table 3.2 and Table 3.3).

#### **Part list**

| No in drawing | Part description                | Remarks / variants                           |
|---------------|---------------------------------|--|
| 1             | Locking strip Cascade           |  |
| 2             | Support bracket water header    |  |
| 3             | Support bracket gas header      |  |
| 4             | Gas Header                      | DN50 / DN80                                  |
| 5             | Support beam                    | for mounting the support brackets            |
| 6             | In-between beam                 |  |
| 7             | Top beam                        |  |
| 8             | L-stand                         |  |
| 9             | Supply header                   | DN65 / DN80 / DN100                          |
| 10            | Return header                   | DN65 / DN80 / DN100                          |
| 11            | Low loss header                 | DN65 / DN80 / DN100                          |
| 12            | Gas connecting set ¾ "          |  |
| 13            | Gas connecting set 1"           |  |
| 14            | Supply connecting set R1¼       |  |
| 15            | Return connecting set R1¼       |  |
| 16            | Supply connecting set R1        |  |
|               | Return connecting set R1        | alternative to 15 – not in figure            |
| 18            | Reducing ring                   |  |
| 19            | Seal cap Rp2                    | DN50 / DN80   to block gas header            |
| 20            | Drain tap G½                    |  |
| 21            | Blind flange                    | DN65 / DN80 / DN100   to block water headers |
| 22            | Air vent                        |  |
| 23            | External temperature sensor     |  |
| 24            | U-bolt M8 x 50-61 2"            |  |
| 25            | U-bolt M8 x 71-77 2½            |  |
| 26            | Square seal plug 50 x 50        |  |
| 27            | Rectangular seal plug 70 x 50   |  |
| 28            | Hexagonal bolt M8x16 DIN933     |  |
| 29            | Hexagonal bolt M8x25 DIN933     |  |
| 30            | Hexagonal bolt M12x60 DIN933    |  |
| 31            | Hexagonal nut M8 DIN934         |  |
| 32            | Hexagonal nut M12 DIN934        |  |
| 33            | Flat washer M8 DIN 125-1A       |  |
| 34            | Flat washer M12 DIN 125-1A      |  |
| 35            | Flat washer large M8x24 DIN9021 |  |
| 36            | Tyrap 385 x 4.8 mm              | for keeping together loose wires and cables  |



[illegible]

## This image shows a full page of white paper with horizontal ruling lines. The lines are evenly spaced and run across the width of the page, typical of notebook or legal stationery. There are no margins, text, or other markings on the page.

[illegible]



## IMPORTANT INFORMATION

These instructions must be read and understood before installing, commissioning, operating or maintaining the equipment.

